



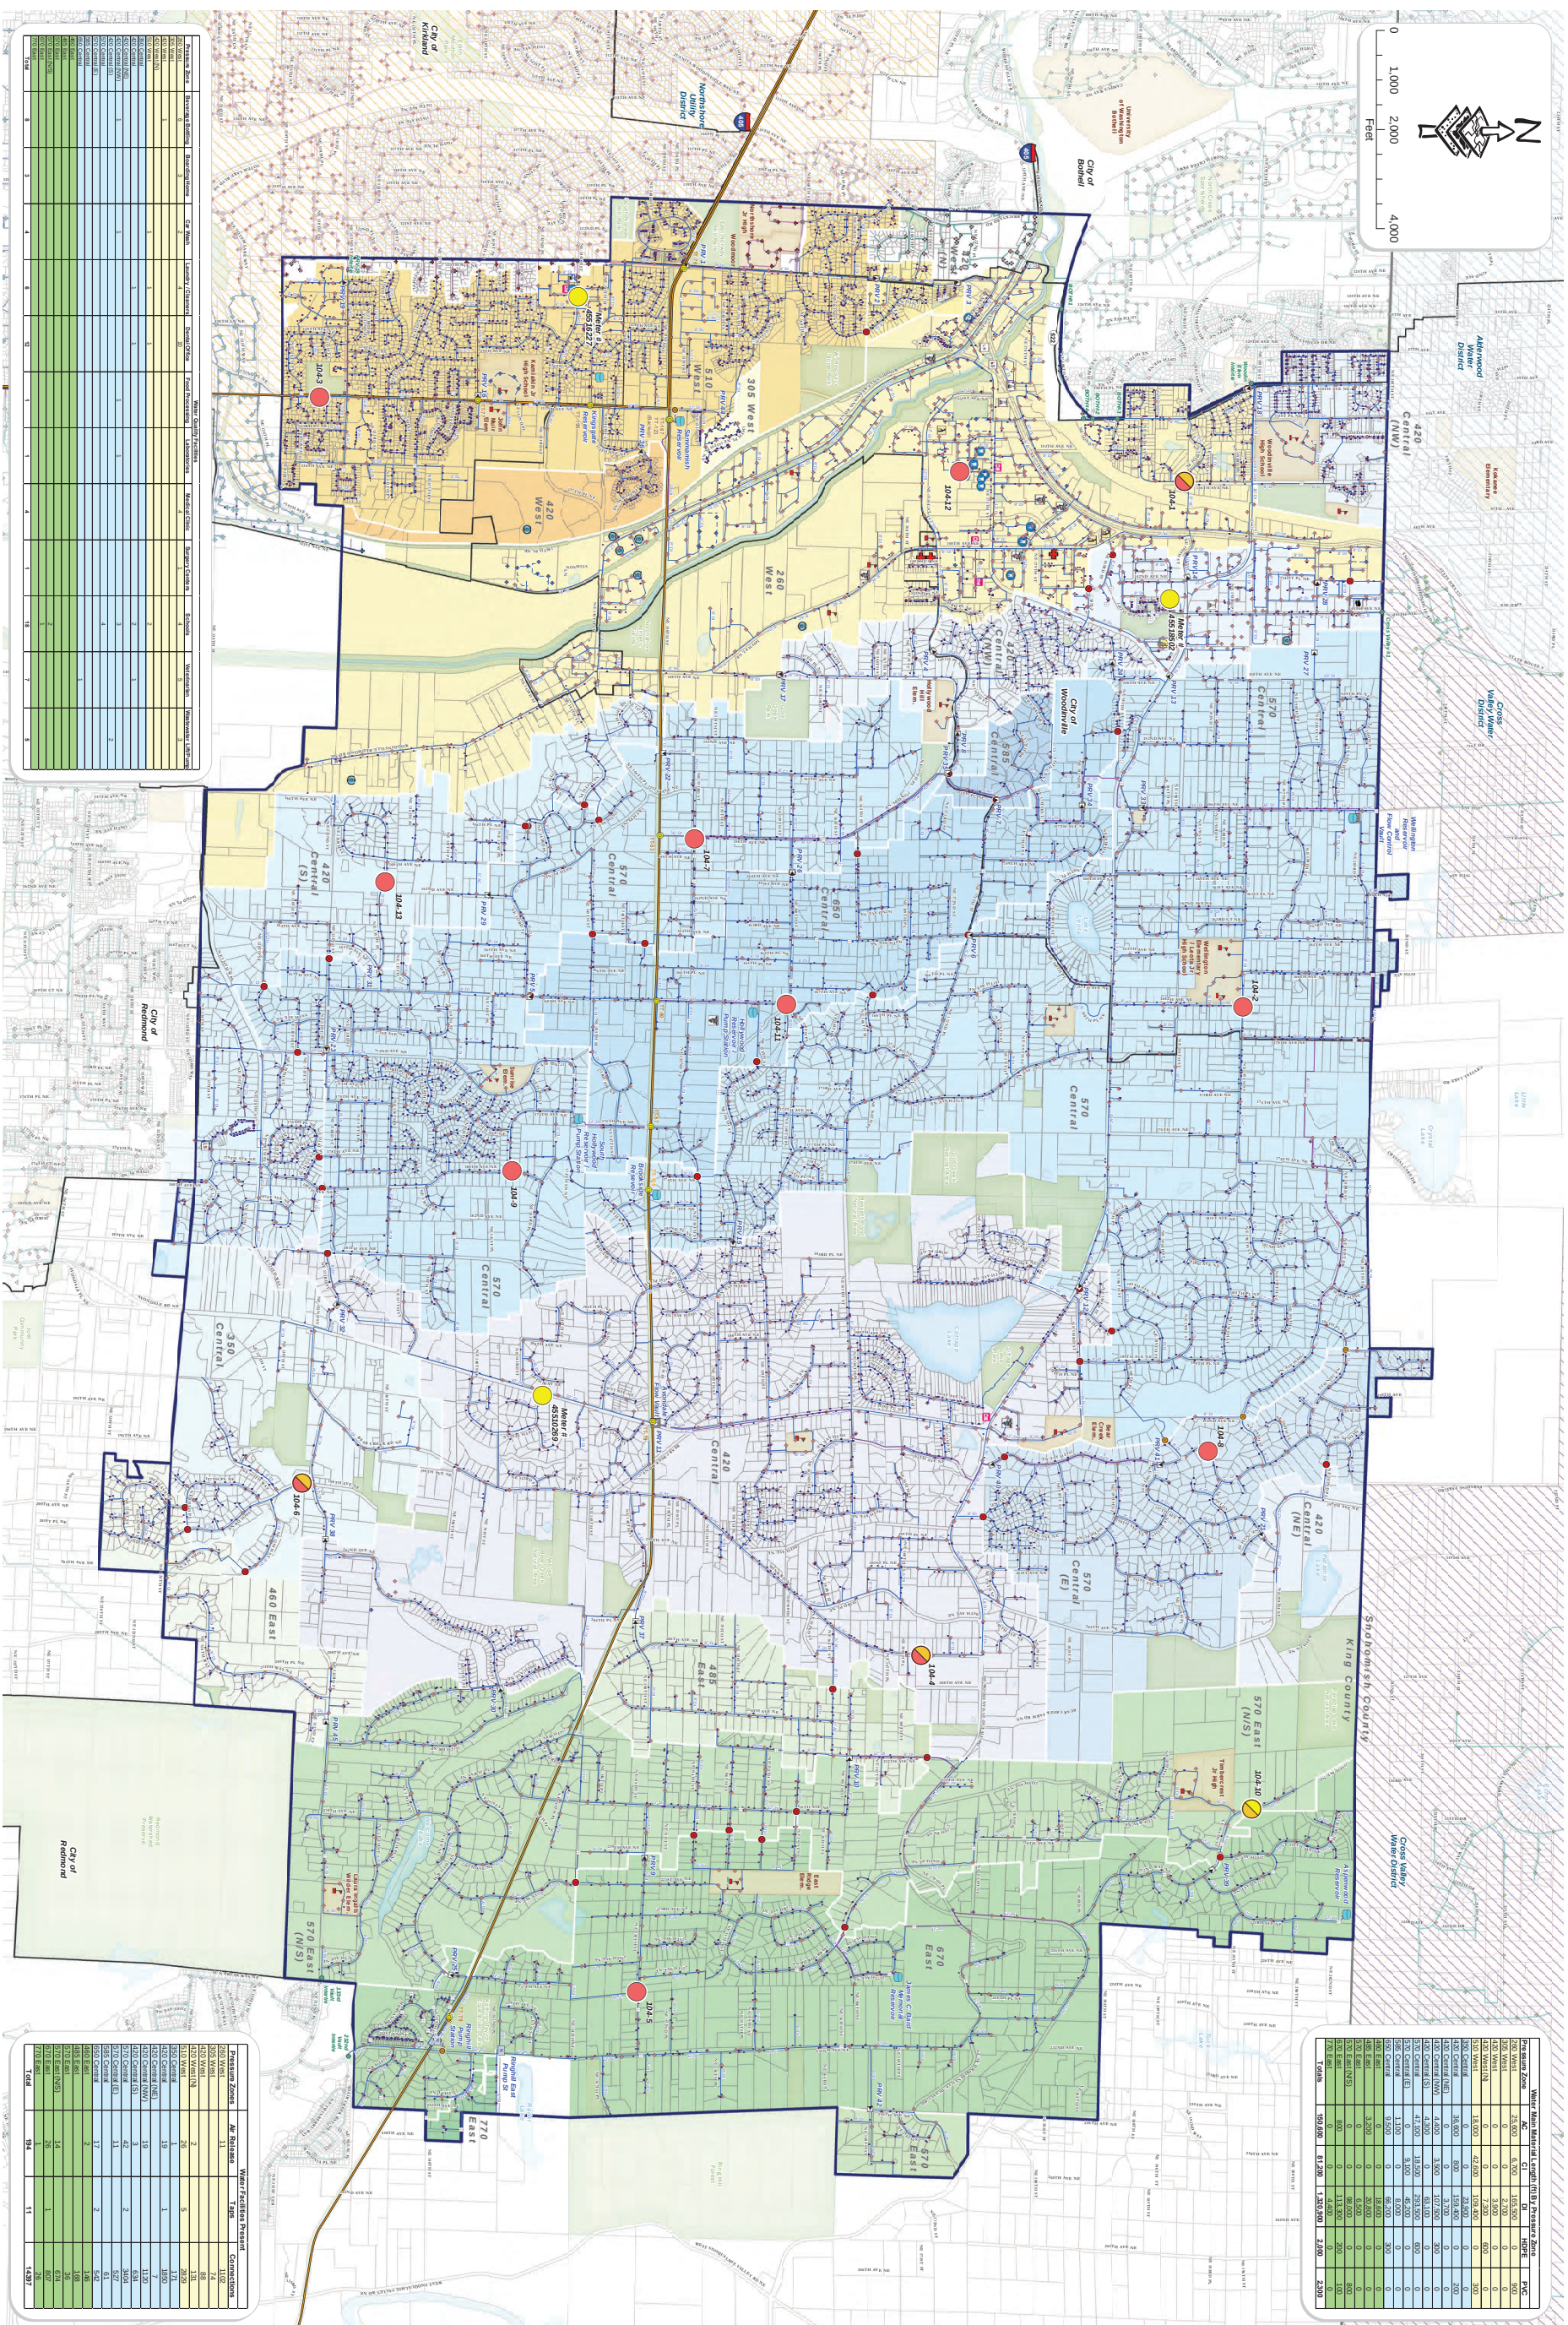

2017 Sample Stand Location Map

Woodinville Water District - 2/3/2017

Sample Stands		Water Quality Facilities		Water System		Pressure Zones	
	Coliform (9)		Beverage Bottling		Storage Facility		260 West
	DBP / Coliform (3)		Out-Patient Clinic/Office		Closed Valve		350 Central
	Baseline / DBP (1)		Schools		Zone Valve		570 Central (E)
	Baseline		Car Wash		Hydrant		485 East
	Sampling (3)		Comm./Laundry/Dry Clean		Private Hydrant		570 East (S)
			Dental Clinics and Offices		PRV		570 East (NS)
			Food Processing Plant		Inertie		420 West (N)
					Well Pumps		420 Central (NV)
					Transmission		420 West (S)
					Distribution		420 West (E)
					Tie Pipeline		570 East (NS)
					WWD Boundary		650 Central
					City Boundary		420 Central (N)
					County Boundary		420 Central (S)
					Service Connection		420 West (E)
							570 East (NS)
							670 East
							770 East

