


6' DIAMETER X 6" THICK
CONCRETE COLLAR FLUSH
WITH CASTING


WATERTIGHT CASTING AND
COVER PER STD. PLAN
DETAIL 20

(1) #4 REBAR RING
POSITION IN CENTER
OF COLLAR.
OVERLAP ENDS 2'
MIN.

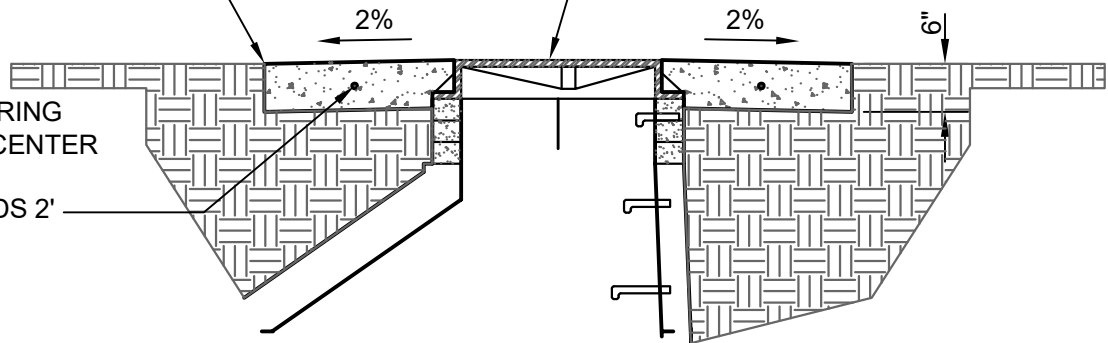

NOTES:

1. NECK OF MH TO BE SEAL WRAPPED IN WET AREAS. SEE STANDARD PLAN 1 & 2 AND SEWER SPECIFICATIONS.
2. SLOPE CONCRETE COLLAR @ 2% AWAY FROM THE TOP OF THE MH LID.
3. APPLY A SMOOTH PROFESSIONAL BROOM FINISH TO CONCRETE SURFACE.
4. CLEAN CONCRETE SLURRY FROM THE MH LID.



Woodinville
Water District

MANHOLE COLLAR
DETAIL



SEWER STD.
PLAN NO. (21)

REVISION DATE
12-20