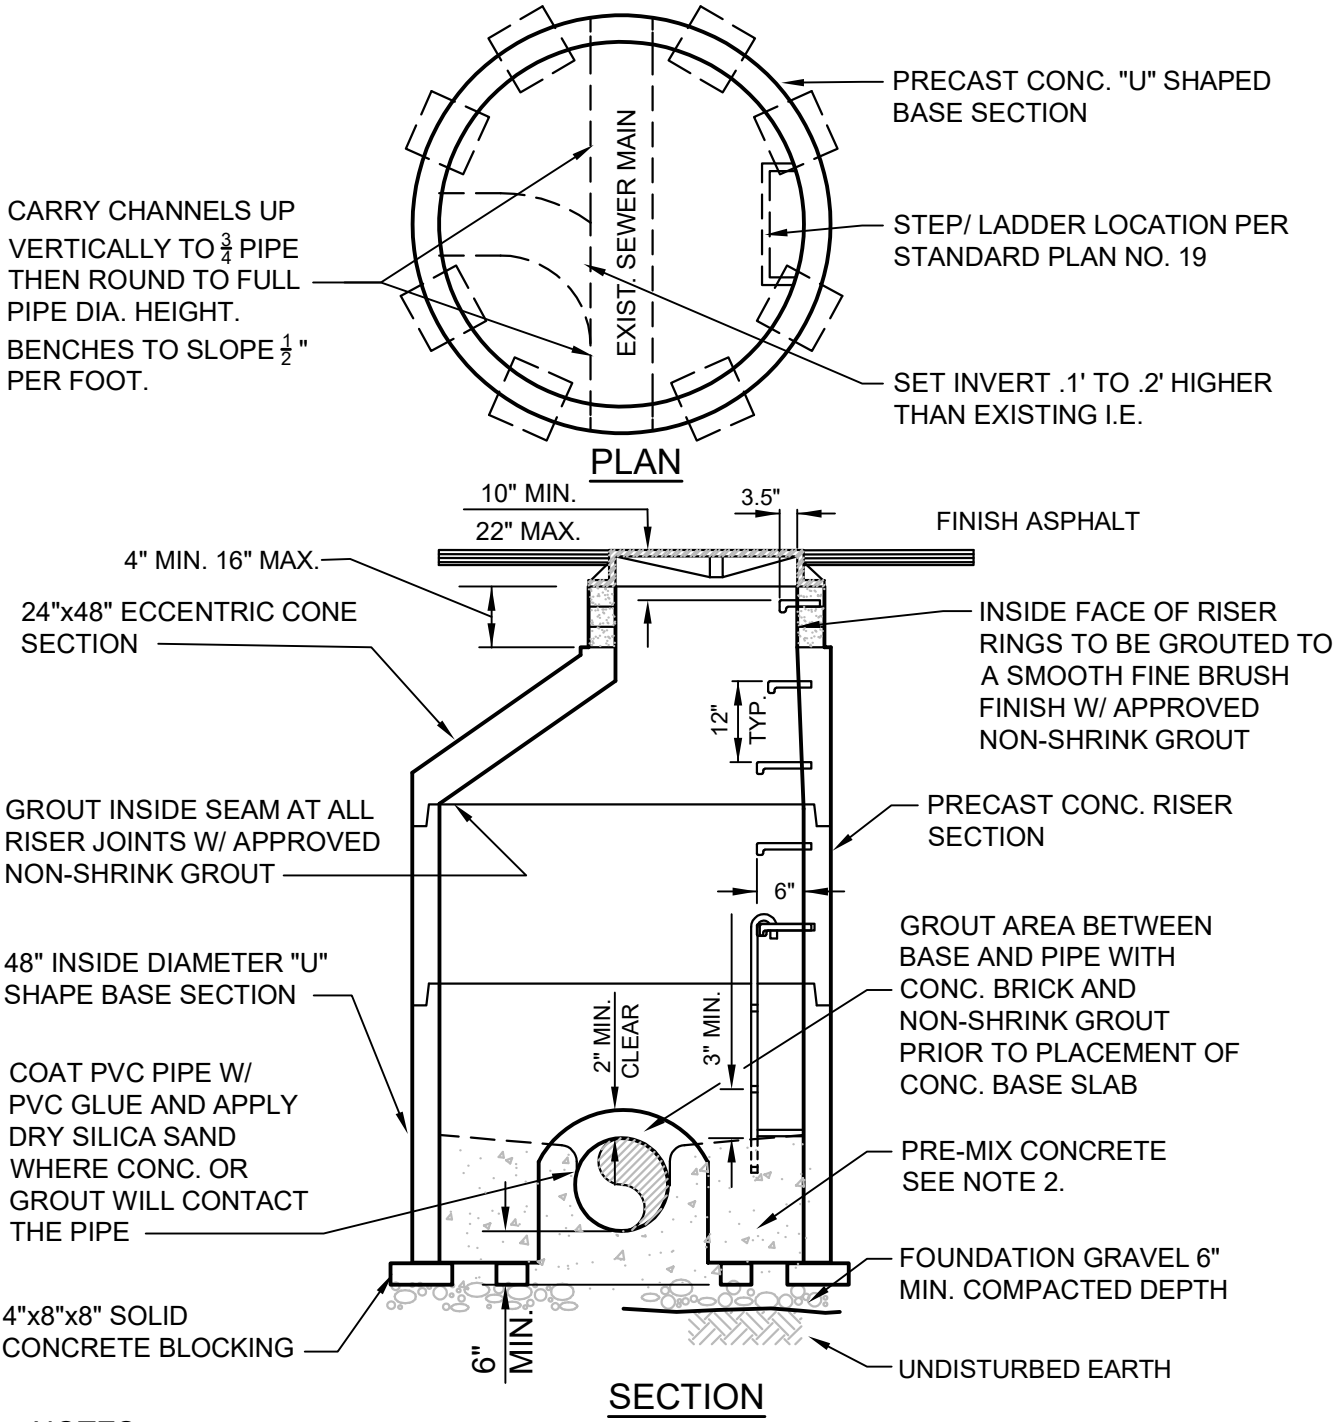

NOTES:

1. ALL APPLICABLE DETAILS & NOTES FROM STANDARD PLAN 2 (STANDARD PRECAST MH) APPLY TO SADDLE MH.
2. 3000 PSI PRE-MIX CONCRETE W/ AIR-ENTRAINMENT SHALL BE PLACED FROM 6" (MIN.) UNDER SEWER MAIN TO FINISH BENCH HEIGHT. CHANNELING SHALL BE COMPLETED AT TIME OF PLACEMENT. THIN OVERLAY OF GROUT IN CHANNELS NOT ALLOWED.
3. TOP OF PIPE NOT TO BE CUT OUT UNTIL AUTHORIZED BY THE DISTRICT.

Woodinville Water District	SADDLE MANHOLE DETAILS	KENNETH F. McDOWELL STATE OF WASHINGTON 29688 REGISTERED PROFESSIONAL ENGINEER EXPIRES 05/14/19	SEWER STD. PLAN NO. 3 REVISION DATE 12-20