


PLAN

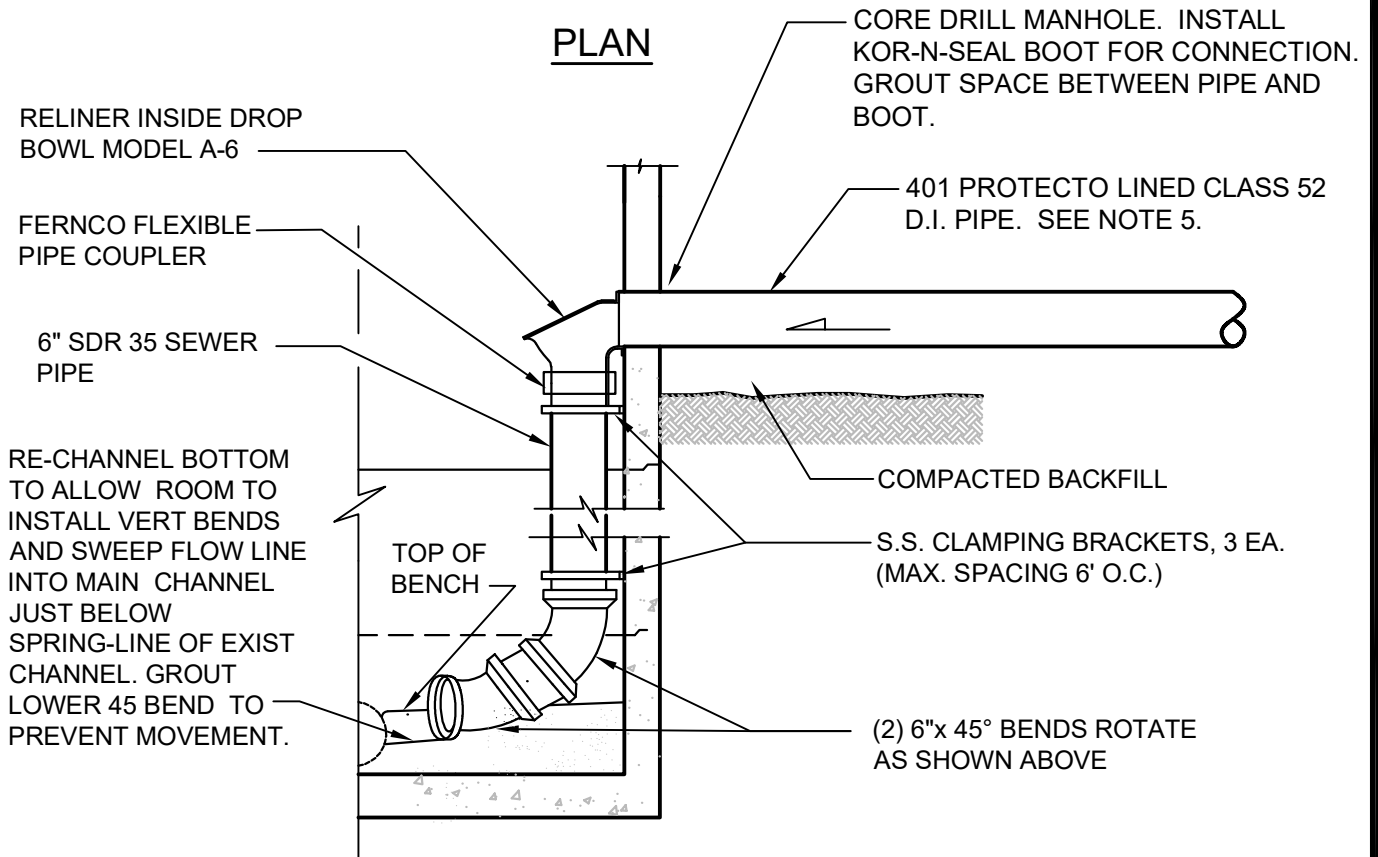


ELEVATION

NOTES:

1. INSIDE DROP ALLOWED ONLY WITH SPECIFIC APPROVAL FROM THE DISTRICT.
2. 8" MAX. SIZE INLET. DEPENDING ON FLOWS THE DROP PIPE DROP AND BENDS MAY HAVE TO BE UPSIZED TO 8".
3. RELINER INSIDE DROP BOWL AND CLAMPING BRACKETS AS MANUFACTURED BY RELINER/DURAN INC. (860)434-0277.
4. MIN. SIZE MH FOR INSIRE DROP IS 60".
5. 401 PROTECTO LINED CLASS 52 DUCTILE IRON PIPE TO BE INSTALLED FROM DROP LOCATION TO THE NEXT UPSTREAM MANHOLE.

INSIDE DROP MANHOLE CONNECTION

NOT TO SCALE



**Woodinville
Water District**

**INSIDE DROP
DETAIL**



**SEWER STD.
PLAN NO. 7**

**REVISION DATE
12-20**