


PLACE SAND OR $\frac{5}{8}$ " CRUSHED ROCK BEDDING 6" UNDER AND OVER SERVICE LINE AND AROUND CONNECTION TO THE MAIN. BARE END OF TRACE WIRE AND ATTACH TO SADDLE.

12 GAUGE TRACER WIRE WRAP AROUND ENTIRE LENGTH OF PIPE WITH 2" MIN. EXTRA IN BOX

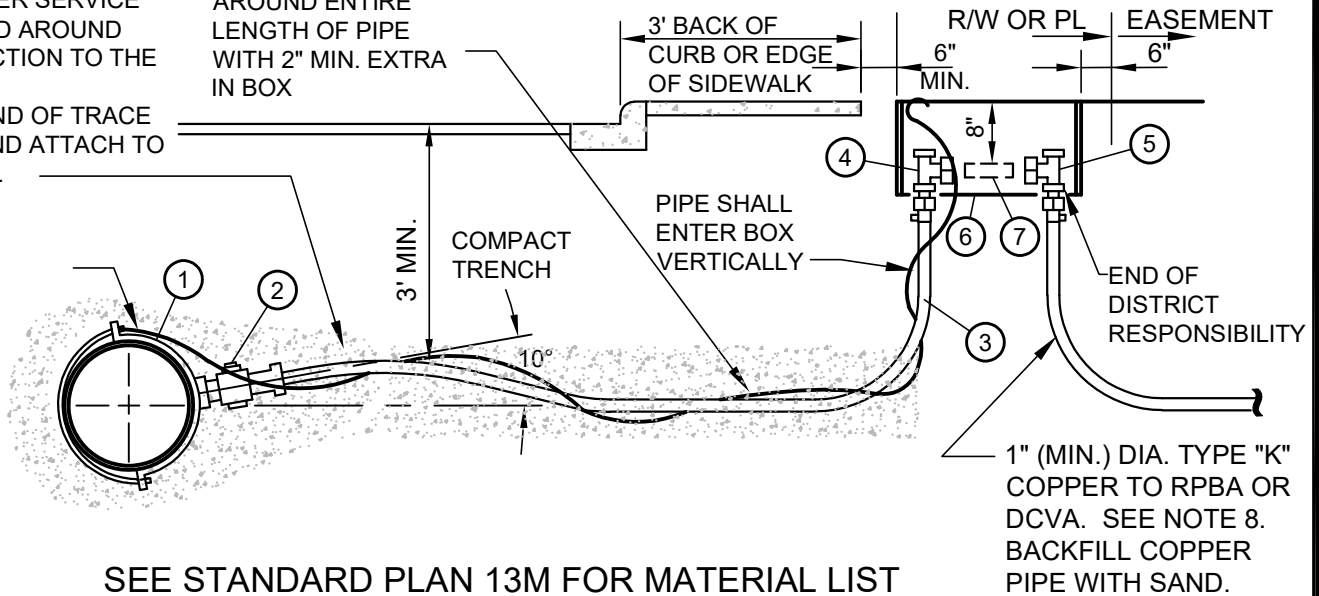


SEE STANDARD PLAN 13M FOR MATERIAL LIST

NOTE - CIRCLED NUMBERS ABOVE REFER TO MATERIALS LISTED ON STD PLAN 13M.

NOTES:


1. CONTRACTOR TO PROVIDE ALL MATERIALS.
2. TRACE WIRE MUST BE VISIBLE IN THE METER BOX.
3. NO SPLICES ALLOWED IN SERVICE LINES.
4. CORP STOP LOCATION SHALL BE OFFSET PRECISELY FOR GPS SURVEY.
5. LOCATE METER BOX OUT OF PAVING OR SIDEWALKS. METER BOX SHALL BE PERPENDICULAR TO THE SIDEWALK OR AS DIRECTED BY THE DISTRICT.
6. CONTRACTOR SHALL SCHEDULE SERVICE FLUSH WITH THE DISTRICT'S INSPECTOR. TAPPING COUPON TO BE PRESENTED TO THE DISTRICT INSPECTOR. SERVICES TO BE TESTED UNDER MAINLINE PRESSURE.
7. METER INSTALLATION BY THE DISTRICT. METER WILL NOT BE SET UNTIL PROJECT ACCEPTED.
8. THE BACKSIDE OF ALL SERVICES SHALL BE PLUMBED IN TYPE "K" COPPER AND HAVE BACKFLOW PROTECTION. DOMESTIC WATER SHALL CONNECT TO A RPBA PER STD. PLAN 19. IRRIGATION AND FIRE METERS SHALL CONNECT TO A DCVA PER STD PLAN 21.
9. IF FIRE OR IRRIGATION SERVICE IS REQUIRED, IT SHALL BE A SEPARATE DEDICATED SERVICE.
10. FIRE SERVICE SHALL BE SIZED ACCORDING TO FLOW REQUIREMENTS NEEDED.

NOTE: ALL BRASS COMPONENTS SHALL CONFORM TO THE LATEST VERSIONS OF NSF 61 AND ANSI/AWWA STANDARD C800 AND SHALL BE STAMPED/ EMBOSSED TO SHOW THE PRODUCT IS MADE FROM A NO LEAD ALLOY.



**Woodinville
Water District**

**1" COMMERCIAL
SERVICE CONNECTION**



**WATER STD.
PLAN NO. 16**

REVISION DATE
12-20