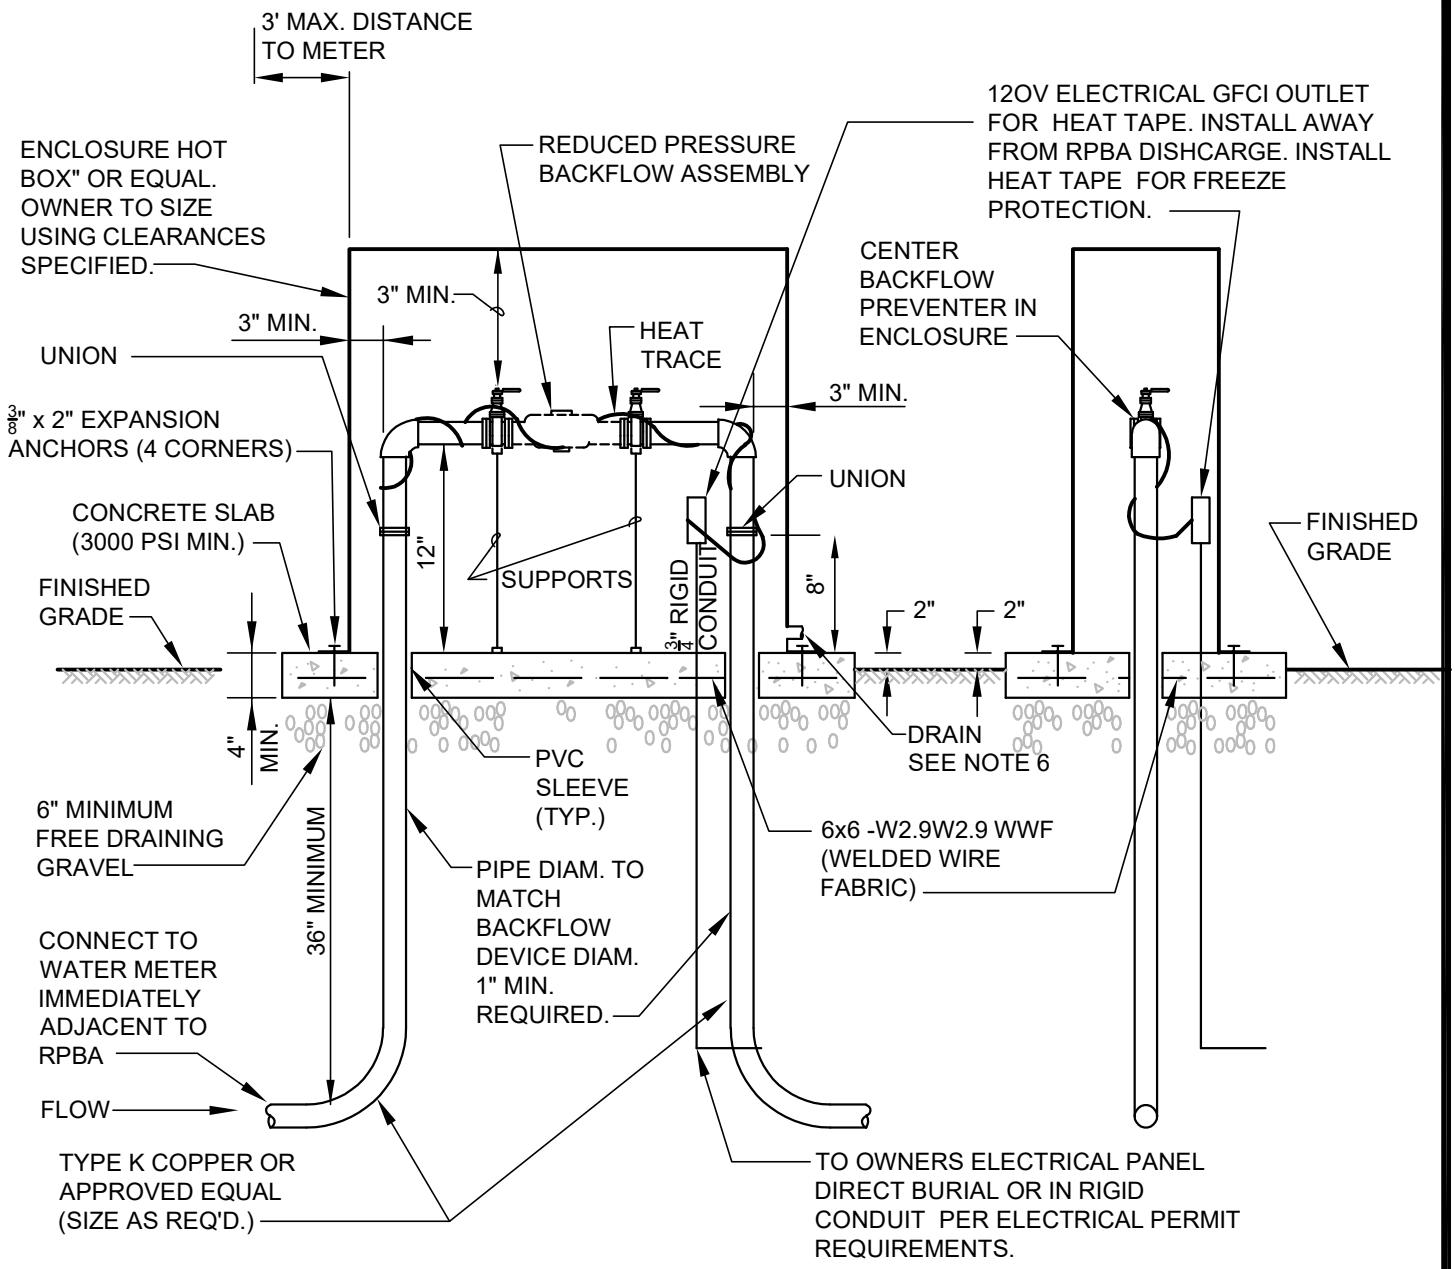


## NOTES:

1. PROVIDE DISTRICT APPROVED SUPPORT FOR DEVICES LARGER THAN 1" DIAMETER.
2. OWNER SHALL FURNISH, INSTALL AND MAINTAIN THE RPBA AND ALL PIPING APPURTANCES SHOWN ON THIS PLAN.
3. DISTRICT WILL PROVIDE INSPECTION AND INITIAL TEST OF THE RPBA PRIOR TO ESTABLISHMENT OF WATER SERVICE.
4. REDUCED PRESSURE BACKFLOW ASSEMBLIES SHALL BE STATE APPROVED DEVICES.
5. SUBSEQUENT ANNUAL TESTING OF RPBA REQUIRED BY OWNER.
6. DRAIN SHALL BE SIZED IN ACCORDANCE WITH AWWA CROSS CONNECTION CONTROL MANUAL FIGURE 6-8.

Woodinville Water District

# 2" AND SMALLER REDUCED PRESSURE BACKFLOW ASSEMBLY

KENNETH F. McDONNELL — STATE OF WASHINGTON — 29688 — REGISTERED PROFESSIONAL ENGINEER — EXPIRES 05/14/21

WATER STD. PLAN NO. 19

REVISION DATE 12-20