


4' BURY DISTRICT APPROVED FIRE HYDRANT

CAST IRON VALVE BOX AND LID W/ VALVE NUT EXT. AND COLLAR SEE STD. PLAN 6

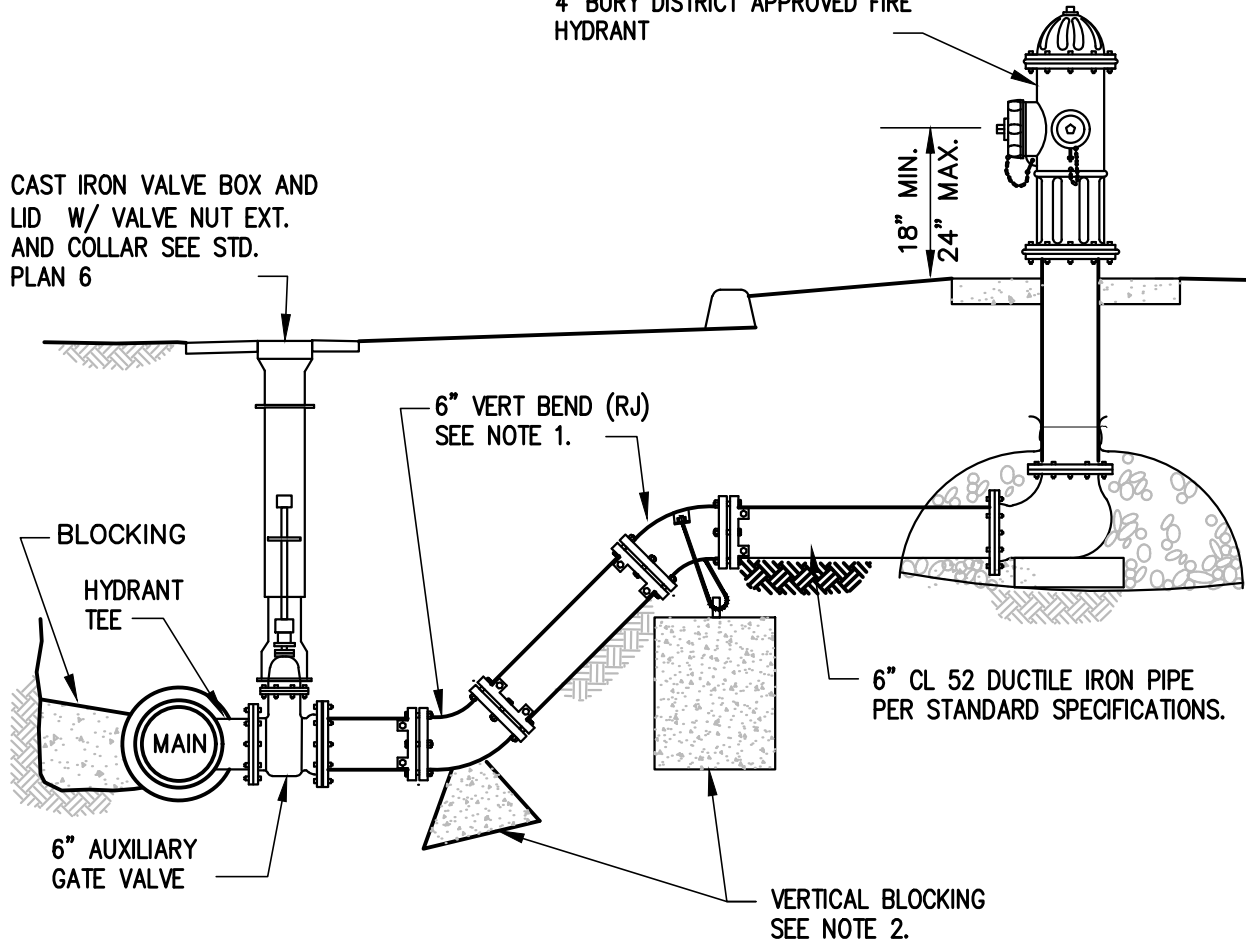


NOTES:

1. MAX. BURY DEPTH FOR FIRE HYDRANTS SHALL BE 6'. FOR DEEPER INSTALLATIONS INSTALL A 4' BURY FIRE HYDRANT WITH VERTICAL BENDS AS SHOWN. 45° MAX. VERTICAL BEND.
2. INSTALL GRAVITY BLOCKING PER STANDARD PLAN NO. 4
3. SEE STANDARD PLANS 9A, 9B AND STANDARD SPECIFICATIONS FOR NEW HYDRANT INSTALLATION REQUIREMENTS.



**Woodinville
Water District**

**DEEP FIRE
HYDRANT INSTALLATION**



**WATER STD.
PLAN NO. 90**

REVISION DATE

9-07