



INSTALL 2" DIA. TEMP BLOW OFF FOR 8" DIA. AND SMALLER AND 3" FOR LARGER THAN 8" DIA.

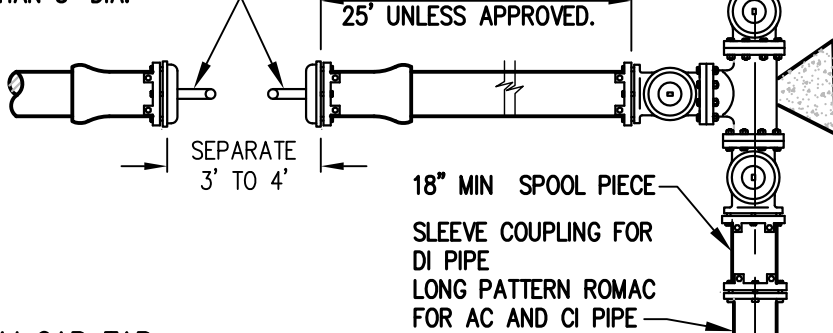

CUT-IN CONNECTION
NOT TO SCALE

MJ CAP TAP
2" FOR 8" OR SMALLER AND 3" FOR 8" AND LARGER.





2" GALV PIPING
2" GATE OR BALL VALVE W/ 2.5" MNST FIRE HOSE CONNECTION.
UPSIZE TO 3" IF MAINLINE LARGER THAN 8".

TEMP BLOW-OFF


NOTES:

PIPE MAY DIRECTLY CONNECT AND EXTEND OUT OF THE STREET PER CONDITIONS IN NOTE 11. ALL PIPE AND FITTINGS SHALL BE RESTRAINED JOINTS. MAX LENGTH 25' UNLESS APPROVED.

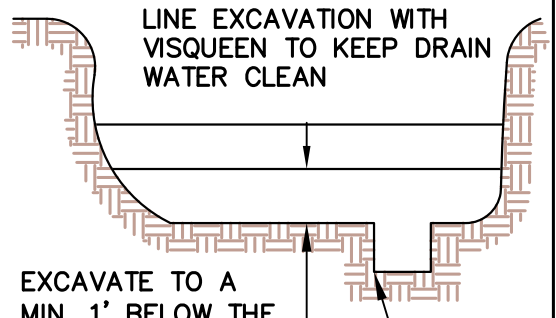


EXCAVATE TO A MIN. 1' BELOW THE EXISTING PIPE.
PROVIDE DEEP SUMP FOR PUMPING OUT WATER

TRENCH PREPARATION



TAPPING SLEEVE (SEE NOTES 1&2)


CONC. THRUST BLOCKING (SEE STD. PLAN 3)



4"x8"x16" CONC. BLOCKS SHIM W/ WEDGES TO SUPPORT PIPE.

TAPPED CONNECTION
NOT TO SCALE

1. CONTRACTOR SHALL SUBMIT E-MAIL REQUEST FOR SHUT DOWN (TIME AND DATE - SEE NOTE 8).
2. TAPPED CONNECTIONS NOT ALLOWED WITHOUT SPECIFIC APPROVAL FROM THE DISTRICT.
3. NO CONNECTION WILL BE ALLOWED UNTIL ALL PRESSURE TESTING COMPLETED, AND SATISFACTORY BACTERIOLOGICAL TEST RECEIVED. SEE CROSS CONNECTION CONTROL SECTION IN SPECIFICATIONS.
4. TAPPING SLEEVE TO BE STAINLESS STEEL FOR AC PIPE AND EPOXY COATED STEEL FOR DUCTILE OR CAST IRON PIPE. CLOSEST EDGE OF TAPPING SLEEVE MUST BE 3' (MIN.) FROM COUPLING ON AC PIPE.
5. SEE STANDARD PLANS 6 (VALVE BOX), 3 (THRUST BLOCKING) & 2 (PIPE AND FITTING RESTRAINT REQUIREMENTS.)
6. BACKFILL PER JURISDICTIONAL REQUIREMENTS WHEN IN ASPHALT. ALL OTHER AREAS PER THE STANDARD SPECIFICATIONS.
7. TEMP BLOW OFF'S MUST BE PROTECTED FROM DAMAGE. PLACE IN TRAFFIC BOX. TEMP BLOW OFFS IN PUBLIC R/W AREAS SHALL BE PLACED OUT OF PAVING. PROVIDE 2.5" MNST FIRE HOSE CONNECTION SEE DETAIL ABOVE.
8. WATER OUTAGE ONLY ALLOWED TUESDAY THROUGH THURSDAY 9:00AM TO 3:00PM. (7) WORKING DAYS NOTICE REQUIRED. AFTER HOUR CONNECTION MAY BE REQUIRED IF A BUSINESS, SCHOOL, ETC. IS IMPACTED.
9. ALL MJ JOINTS TO BE MEGALUG OR EQUAL.
10. SIMILAR TEMP B.O. REQUIREMENTS FOR TAPPED CONNECTIONS. LOCATE BLOW OFF OUT OF ASPH. WHEN POSSIBLE.
11. ALL PIPE, FITTINGS AND OTHER COMPONENTS USED IN CONNECTIONS AND THE STUB ON TO SITE SHALL BE STERILE SWABBED W/ PIPE SIZE FOAM PIG AS PART OF THE PROJECT PIGGING REQUIREMENTS CONNECTIONS SHALL BE TESTED UNDER FULL LINE PRESSURE PRIOR TO BACKFILL. THE STUB ONTO SITE SHALL BE PRESSURE TESTED (AT 200PSI) IN THE PRESENCE OF THE DISTRICT INSPECTOR.



**Woodinville
Water District**

**CONNECTION
REQUIREMENTS**



**WATER STD.
PLAN NO. 1**

**REVISION DATE
10-16**