

SURFACE RESTORATION IN ACCORDANCE WITH LOCAL JURISDICTIONAL REQUIREMENTS. MINIMUM REQUIREMENTS SHOWN IN TRENCH PAVEMENT & SURFACE RESTORATION DETAIL NO. 10.


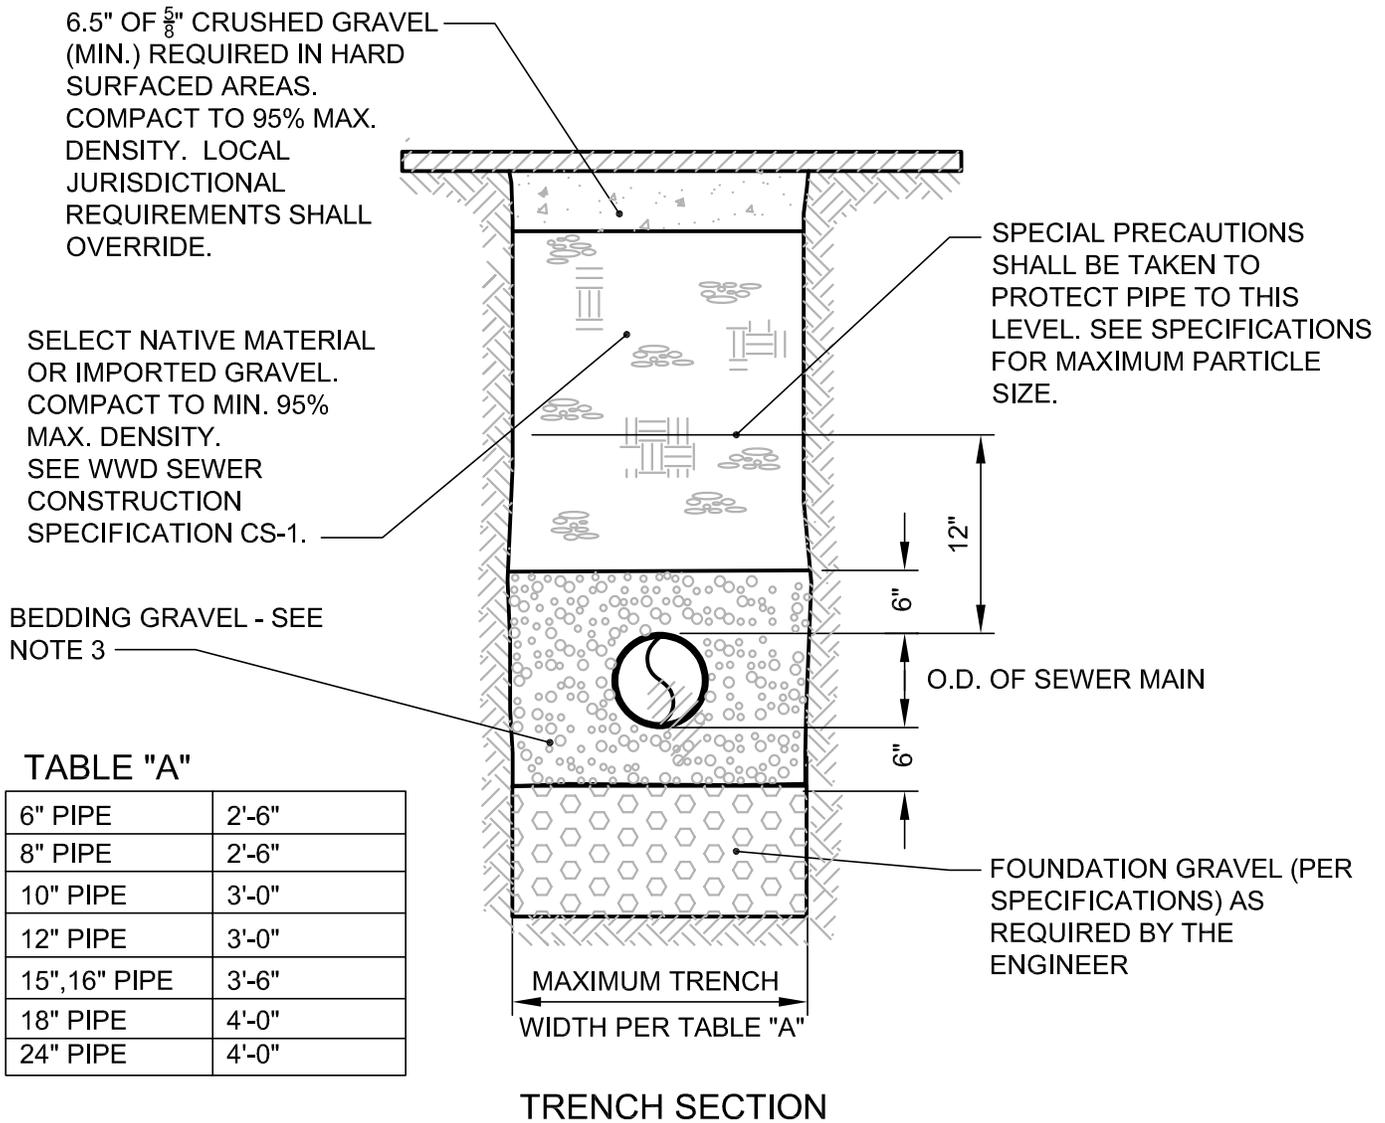


TABLE "A"

6" PIPE	2'-6"
8" PIPE	2'-6"
10" PIPE	3'-0"
12" PIPE	3'-0"
15", 16" PIPE	3'-6"
18" PIPE	4'-0"
24" PIPE	4'-0"

NOTES:

1. LOCAL JURISDICTION REQUIREMENTS OVERRIDE ALL APPLICABLE SECTION OF THIS DETAIL. WHEN WORKING IN A STREET RIGHT OF WAY REFER TO ALL LOCAL JURISDICTIONAL REQUIREMENT FOR TRENCH EXCAVATION AND BACKFILL.
2. FILL AREAS SHALL BE FILLED AND COMPACTED PRIOR TO INSTALLATION OF WATER MAINS. 95% COMPACTION PER ASTM D-1557 REQUIRED IN FILL AREAS. REPORTS REQUIRED PRIOR TO TRENCHING.
3. BEDDING SHALL BE PEA GRAVEL OR $\frac{5}{8}$ " MINUS CRUSHED SURFACING. TRENCH DAMS (PER THE STANDARD PLANS) SHALL BE INSTALLED IN WET AREAS AS DIRECTED BY THE ENGINEER.
4. PUMPING SOILS SHALL BE REMOVED FROM THE TRENCH BACKFILL IMMEDIATELY.
5. USE OF NATIVE SOILS FOR BACKFILL REQUIRES PROCTOR SAMPLES BE TAKEN PRIOR TO EXCAVATION AND RECOMPACTED OR REPLACED UNTIL PASSING TEST RESULTS ARE OBTAINED.



Woodinville
Water District

TYPICAL
LONGITUDINAL
TRENCH SECTION



SEWER STD.
PLAN NO. 8

REVISION DATE
04/25