


6' DIAMETER X 6" THICK
CONCRETE COLLAR FLUSH
WITH CASTING


WATERTIGHT CASTING AND
COVER PER STD. PLAN
DETAIL 20

(1) #4 REBAR RING
POSITION IN CENTER
OF COLLAR.
OVERLAP ENDS 2'
MIN.

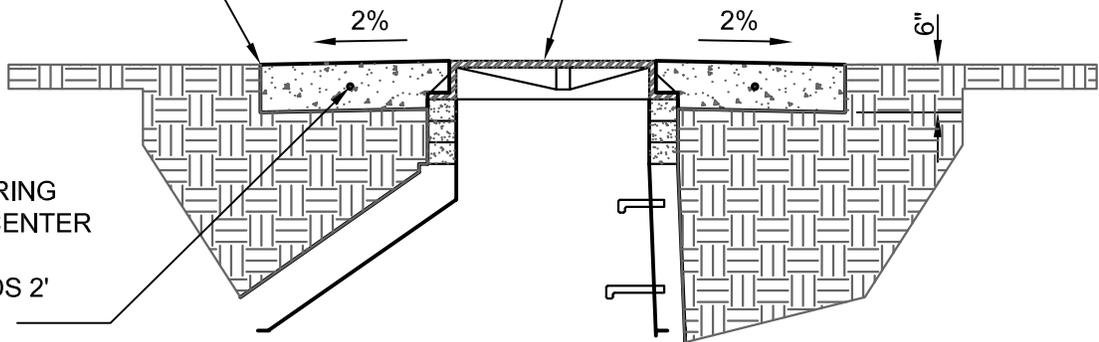

NOTES:

1. ALL APPLICABLE DETAILS FROM SEWER STANDARD PLANS 1 & 2 APPLY TO THIS DETAIL.
2. NECK OF MH TO BE SEALED WITH EXTERNAL JOINT WRAP. DO NOT GROUT ADJUSTMENT RISERS.
3. SLOPE CONCRETE COLLAR @ 2% AWAY FROM THE TOP OF THE MH LID.
4. APPLY A SMOOTH PROFESSIONAL BROOM FINISH TO CONCRETE SURFACE.
5. CLEAN CONCRETE SLURRY FROM THE MH LID.



Woodinville
Water District

MANHOLE COLLAR
DETAIL



SEWER STD.
PLAN NO. (21)

REVISION DATE
04/25