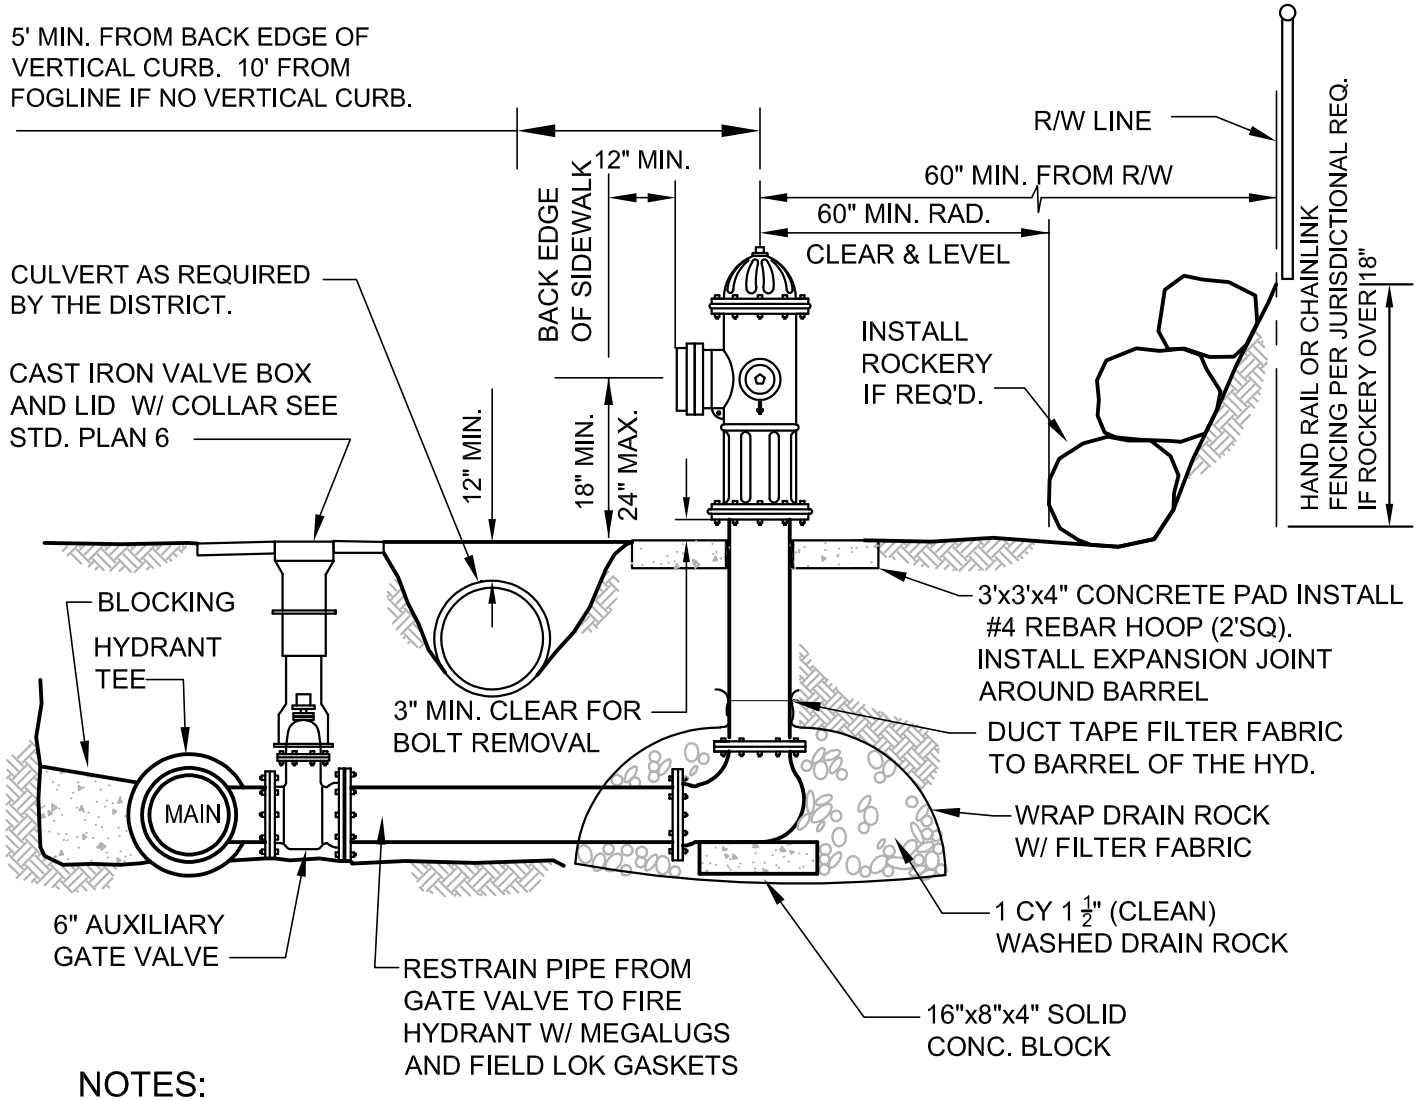


## NOTES:

1. 6" DIA. CL 52 (PER SPEC'S) TO BE USED IF PIPE RUN IS 50' OR LESS. 8" PIPE REQUIRED IF OVER 50'. AN 8"X6" TEE AND 6" GATE VALVE SHALL BE PLACED AT THE END OF AN 8" PIPE RUN WITH 6" D.I. CL 52 TO THE FIRE HYDRANT LOCATION.
2. SEE STANDARD PLANS 3, (THRUST BLOCKING), 6 (VALVE BOX), 7A (TYPICAL LONGITUDINAL & TRANSVERSE TRENCH SECTION), & 8 (TRENCH RESTORATION).
3. PROVIDE LEVEL ACCESS TO FIRE HYDRANT. SEE SPECIFICATIONS.
4. SIDE PORTS SHALL BE 2 1/2" SNT/NH THREADS.
5. A 4" PUMPER PORT WITH SEATTLE THREADS REQUIRED. SEE SPECIFICATION MW-9.
6. INSTALL A 5" STORZ ADAPTER PER WOODINVILLE, BOTHELL, REDMOND, AND KIRKLAND FIRE STANDARD PLANS.
7. THE DEVELOPER SHALL PROVIDE SURVEY TO SET THE BASE ELEVATION (TOP OF CONCRETE PAD) OF THE FIRE HYDRANT. SEE THE DE SPECIFICATION FOR OTHER REQUIREMENTS.
8. MAXIMUM BURY DEPTH ON FH IS 6'. DEEPER INSTALLATION SHALL BE INSTALLED PER STANDARD PLAN 9B.
9. ROTATION OF THE FIRE HYDRANT PUMPER PORT SHALL BE DIRECTED BY THE FIRE AUTHORITY OR DISTRICT STAFF.
10. REMOVE HYDRANT CHAINS.

| | | | |
|---|---|---|---|
| WOODINVILLE WATER DISTRICT — Woodinville Water District | NEW FIRE HYDRANT INSTALLATION | CHRISTIAN R. HOFFMAN, STATE OF WASHINGTON, 42295, REGISTERED PROFESSIONAL ENGINEER — EXPIRES: 11/21/2026 | WATER STD. PLAN NO. 9 — REVISION DATE 04/25 |