



OLD CASTLE 1324BCF-18 WITH DUCTILE IRON LID (H2O LOADING) & HINGED METAL FLAP LOCATE BLOW-OFF BOX AWAY FROM DRAINAGE OR HIGH WATER AREAS. PAINT LID SAFETY BLUE SEE NOTE 2.

$\frac{3}{8}$ " THICK CONCRETE COLLAR TO DIMENSIONS SHOWN. FLUSH WITH FINISH GRADE. REINFORCE WITH #3 REBAR.

SEE THRUST BLOCK DETAILS

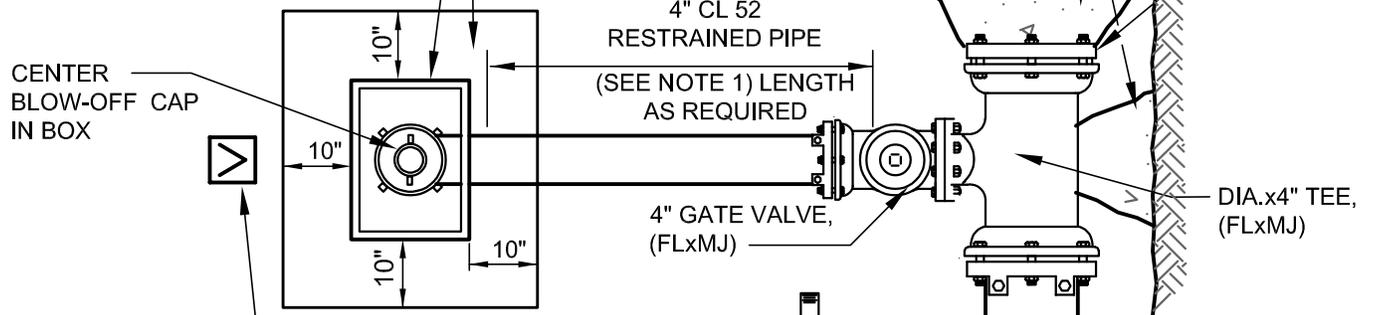


PLAN



DETAIL "A"

BLOW OFF MARKER POST SEE STD. PLAN 23.

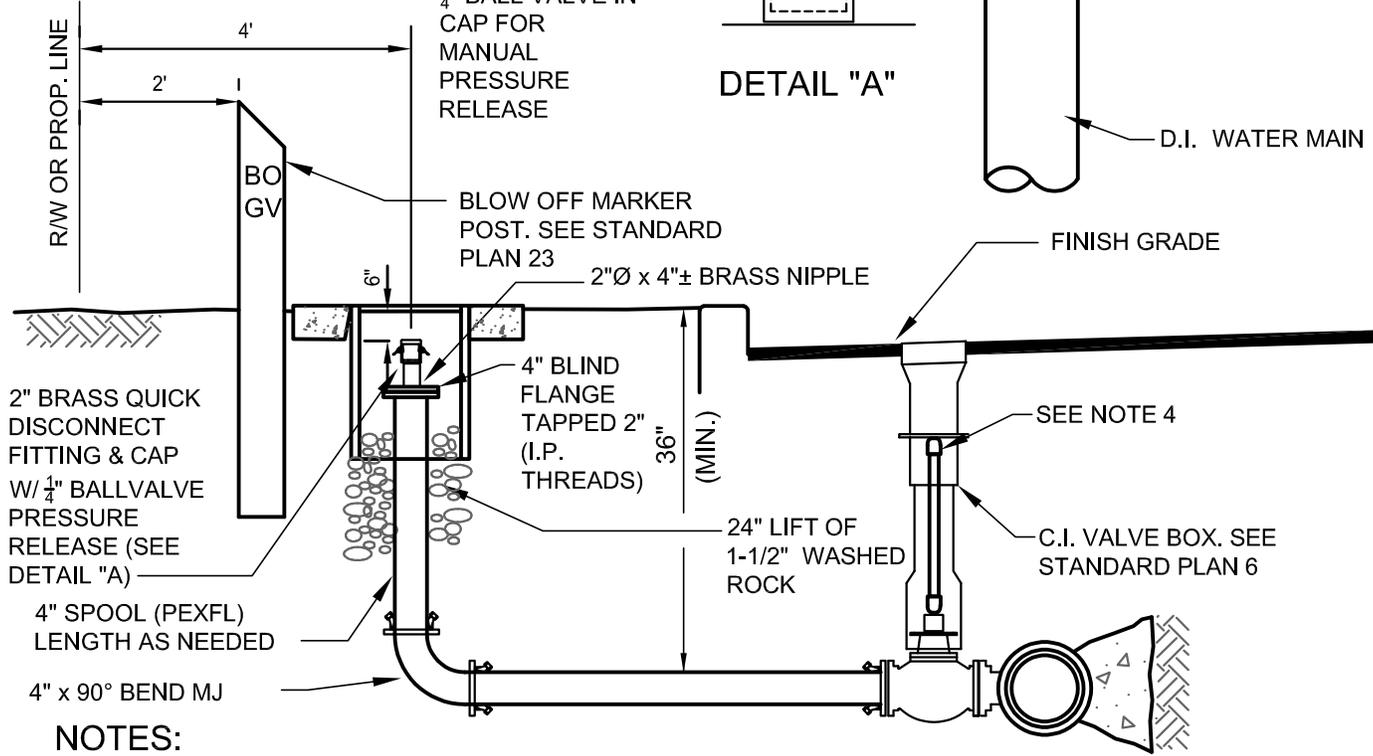


NOTES:

1. MECHANICAL JOINTS (MJ) TO BE RESTRAINED WITH EBBA IRON MEG-A-LUGS. INSTALL FIELD LOK GASKETS IN PIPE JOINTS.
2. VALVE MARKERS TO BE PAINTED (2) COATS OF SAFETY YELLOW. BLOW-OFF BOX LID AND VALVE BOX LIDS TO BE PAINTED (2) COATS OF SAFETY BLUE. SEE MW-24 FOR PAINT SPECIFICATIONS.
3. BLOW OFF BOX NOT ALLOWED IN THE STREET.
4. PLACE VALVE TYPE AND SIZE INDICATOR IN VALVE CHAMBER. SEE STANDARD PLAN 23.



**Woodinville
Water District**

**BLOW OFF
ASSEMBLY**



**WATER STD.
PLAN NO. 12**

REVISION DATE
04/25