

PLAN VIEW
NOT TO SCALE

IF SUMP PUMP IS NECESSARY-INSTALL WEATHERPROOF GFCI OUTLET INSIDE VAULT (OWNER TO PROVIDE ELECTRICAL SERVICE)


TERMINATE SUMP PUMP PIPING IN CATCH BASIN

1 1/2" PVC UNION

1 1/2" SCHEDULE 40 PVC


1 1/2" PVC SINGLE CHECK

4" SCH. 40 PVC W/ 12GA. (EXTEND INTO VAULT) TRACER WIRE. 2% MIN. SLOPE. PROVIDE SUMP PUMP IF GRAVITY DRAIN NOT FEASIBLE

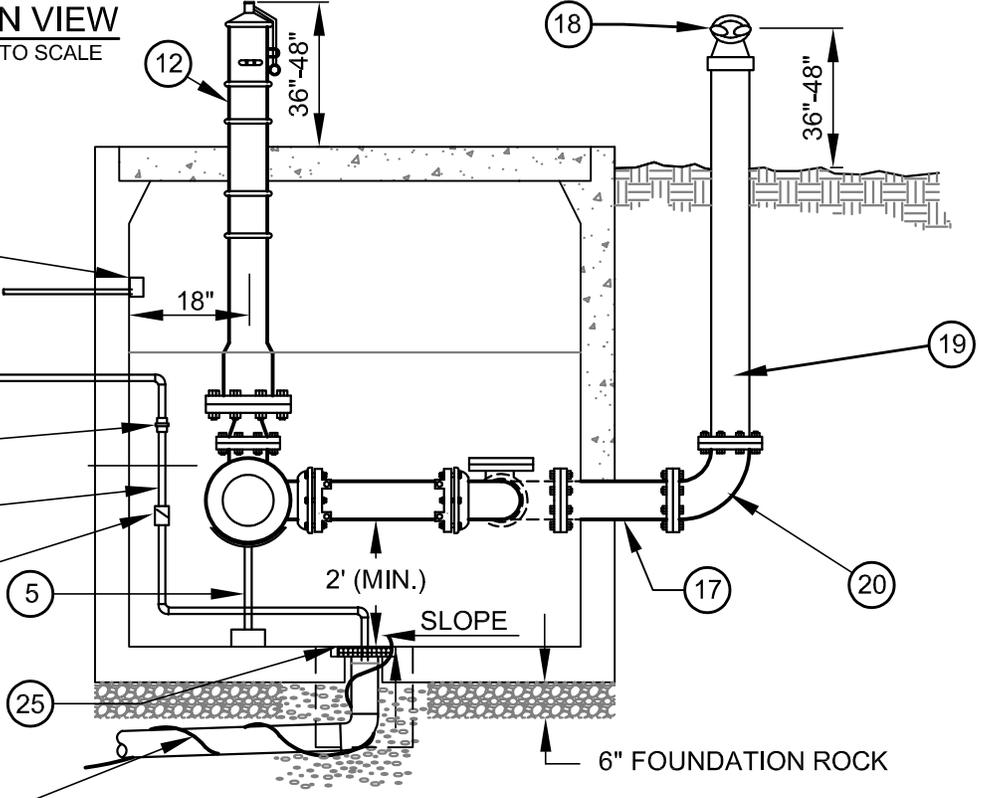


END VIEW
NOT TO SCALE

1. DESIGN FOR 4" THRU 10" DOUBLE DETECTOR CHECK VALVE
2. SEE STANDARD PLAN 25A FOR MATERIAL LIST AND NOTES.



Woodinville
Water District

FIRE SPRINKLER
SERVICE CONNECTION



WATER STD.
PLAN NO. **25**

REVISION DATE
04/25