



LADDER DETAIL

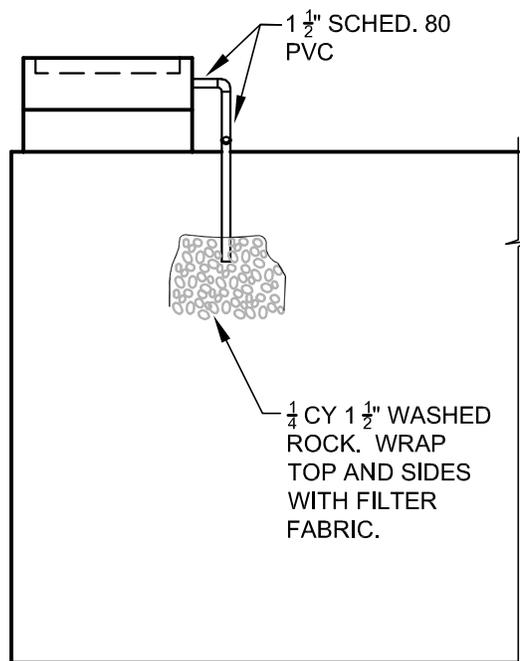

LID GUTTER DETAIL

NOTES:


1. STAINLESS STEEL OR ALUMINUM LADDER WITH LADDER UP - LW PRODUCTS OR APPROVED EQUAL. SUBMITTAL REQUIRED.

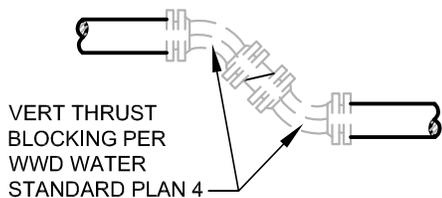

CONNECTION TO EXISTING

NOTES:


1. INSTALL VERTICAL BENDS AS NEEDED TO MATCH EXISTING WATER MAIN ELEVATIONS
2. MAX VERT BEND 45° (TYP)

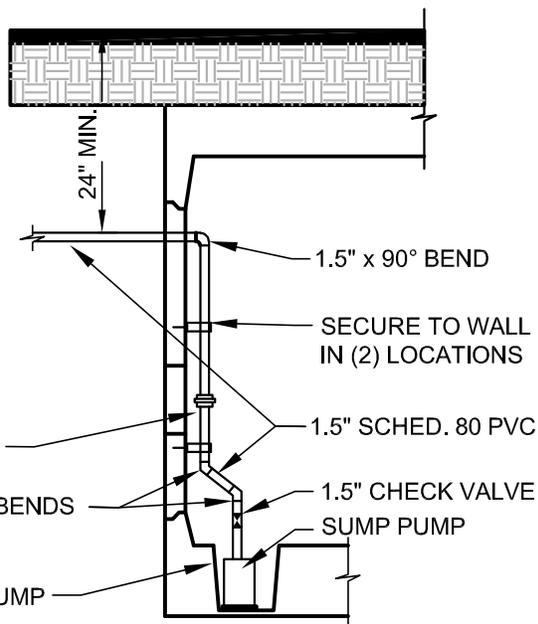

SUMP PUMP DETAIL


NOTES:

1. TERMINATE SUMP PUMP DISCHARGE LINE IN CATCH BASIN OR DAYLIGHT IN LOCATION PROVIDED BY THE DISTRICT
2. PROVIDE ZOELLER CO. SUMP PUMP - PART NO. 54-0001, MODEL NO. M-53-D.



Woodinville
Water District

PRESSURE REDUCING
VALVE STATION
DETAILS



WATER STD.
PLAN NO. 26A

REVISION DATE
04/25